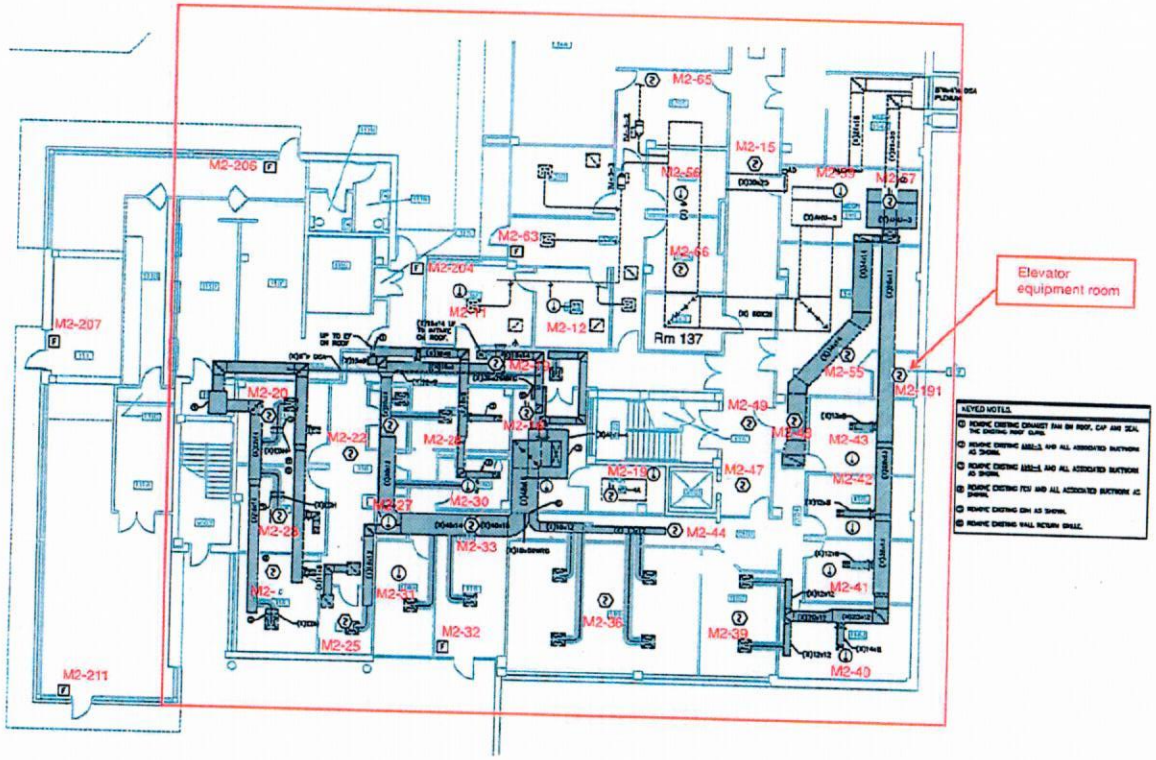

KEYED NOTES

1. REMOVE EXISTING EXHAUST FAN ON ROOF. CAP AND SEAL THE EXISTING ROOF CURB.
2. REMOVE EXISTING AHU-1 AND ALL ASSOCIATED SUCTIONS AS SHOWN.
3. REMOVE EXISTING AHU-2 AND ALL ASSOCIATED SUCTIONS AS SHOWN.
4. REMOVE EXISTING FCU AND ALL ASSOCIATED SUCTIONS AS SHOWN.
5. REMOVE EXISTING CUH AS SHOWN.
6. REMOVE EXISTING WALL RETURN GRILLE.

F Pull Station

Heat Detector

Smoke Detector

KEY PLAN

HVAC DEMOLITION PLAN - FIRST FLOOR | SCALE 1/8"=1'-0" | 1

Facilities Management
1141 West Samford Avenue
Auburn University, AL 36849
Phone: (334) 844-4110
Fax: (334) 844-9258
Safety is our first priority.
Think Safety. Act Safely.

No.	Issue	Date
1	PERMIT FOR BID	1/28/17

EDMONDS

Foy Hall
Replace Multiple Air Handling Units
& Associated Duct Systems
AU Project Number 16-427

SHEET TITLE:
HVAC DEMOLITION PLAN – FIRST FLOOR

DRAWN BY: TPB
CHECKED BY: JNR
DATE: 11/8/17
FILE NUMBER: –
PROJECT NUMBER: AU 16-427
SHEET NUMBER: M1.0
XX of XX